

STANDARTA RASĒJUMI

(PIELIKUMS Nr.11)

Ūdenssaimniecības attīstība Ozolu ciemā,
Liezēres pagastā, Madonas novadā. II kārtā,
papildus darbi

Speed curve




Customer item no.:
Communication dated:
Doc. no.: Ozoli KSS
Quantity: 2

Number: 4002272902
Item no.:200
Date: 16/10/2014
Page: 3 / 4

Amarex NF 65-220/004ULG-155

Version no.: 2

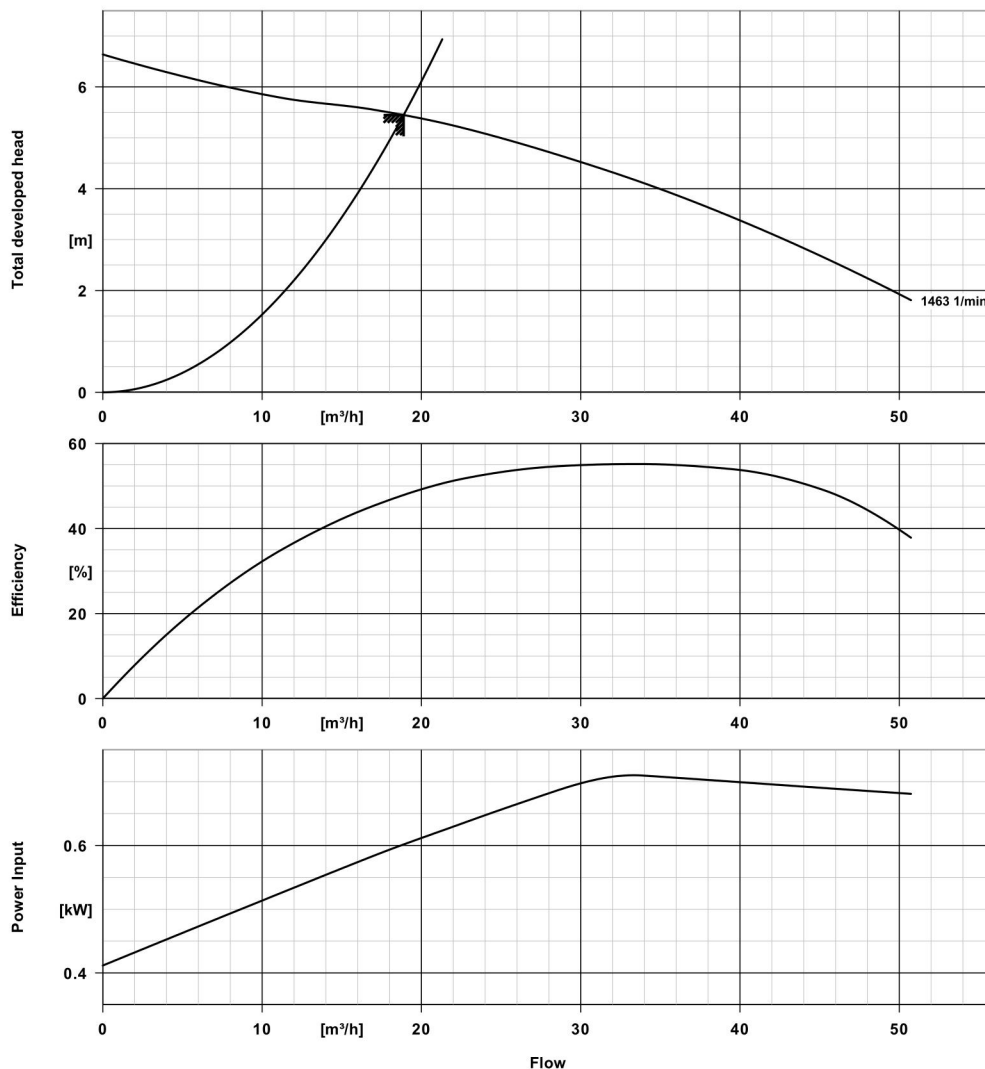

Curve data

Fluid density
Viscosity
Requested flow rate

1030 kg/m³
1.00 mm²/s
19.08 m³/h

Total developed head 5.45 m
Requested developed head 5.56 m
Effective impeller diameter 155.0 mm